

Figure 1

FOOTPRINT 4020400F

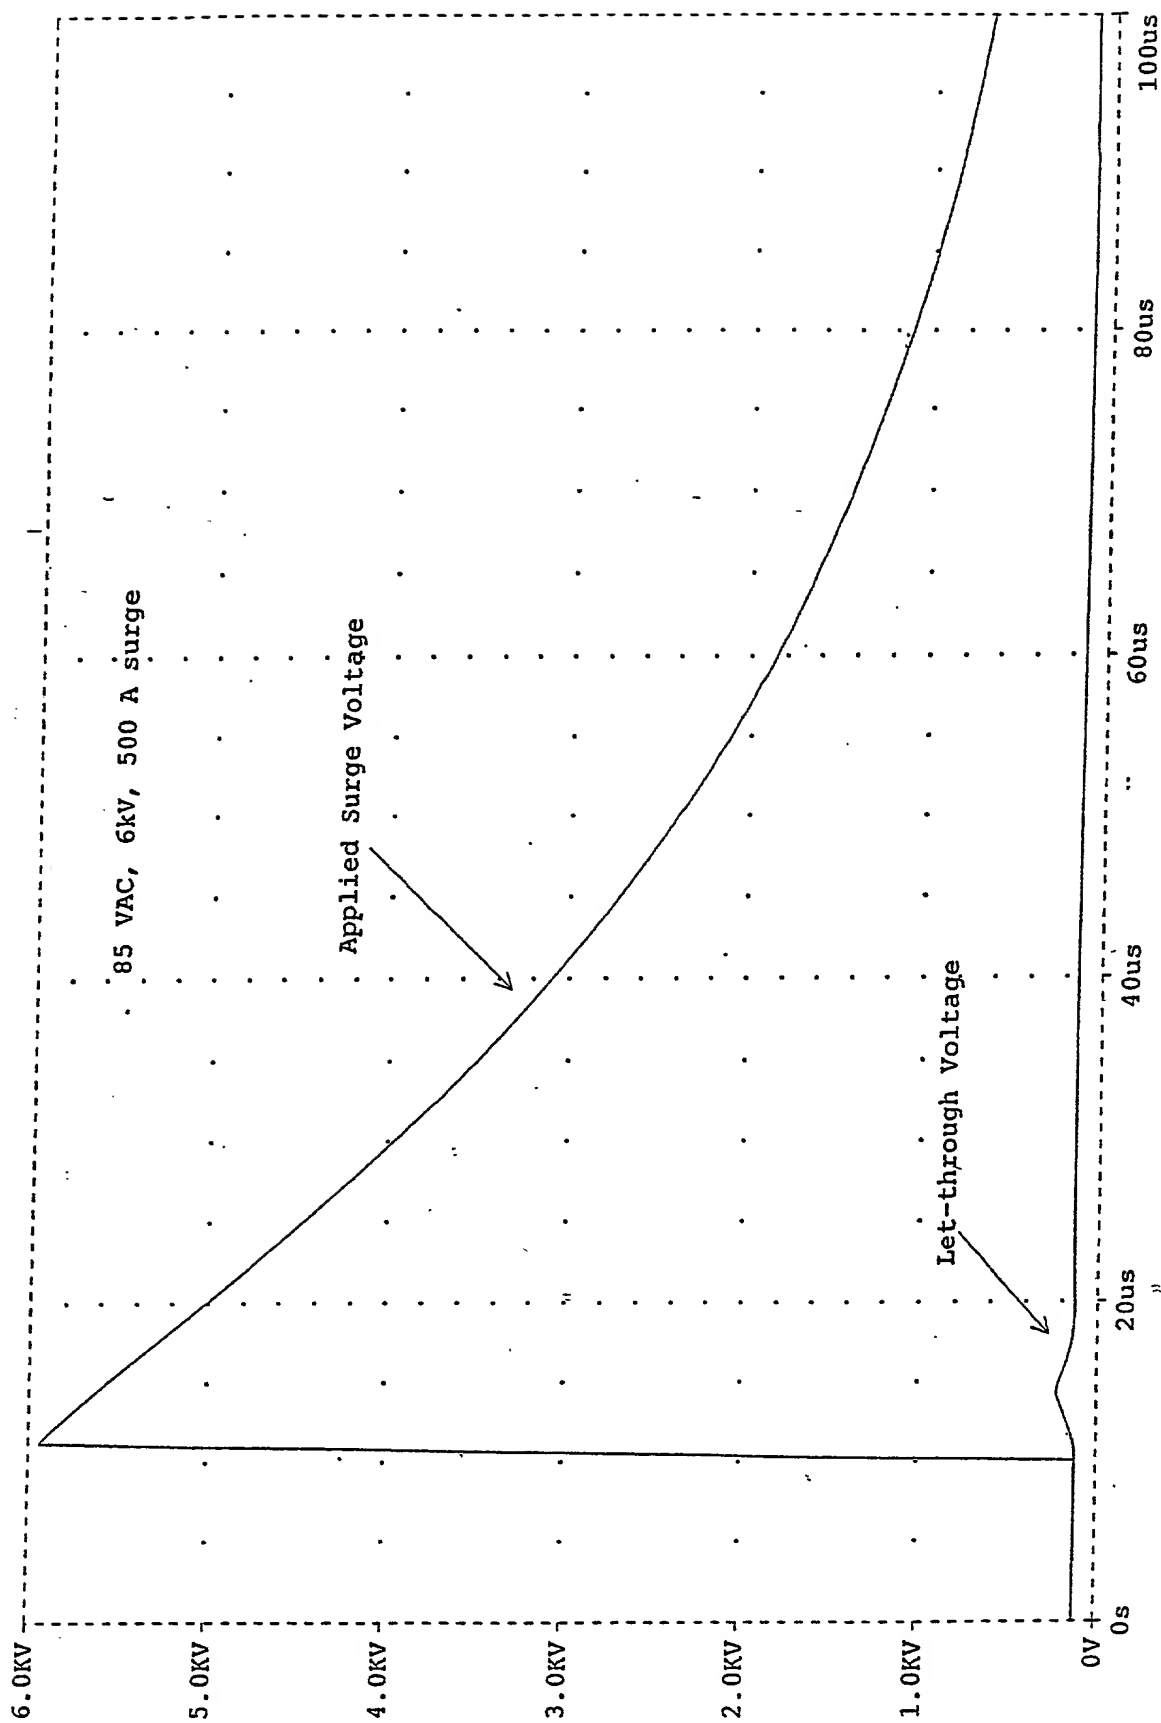


Figure 3

120 VAC, 6 kV, 500 A surge

Applied Surge Voltage

Let-through Voltage

6.0KV
5.0KV
4.0KV
3.0KV
2.0KV
1.0KV
0V

0s 20us 40us 60us 80us 100us

Time

Figure 4

Figure 4

FOOTPRINT 4020400T

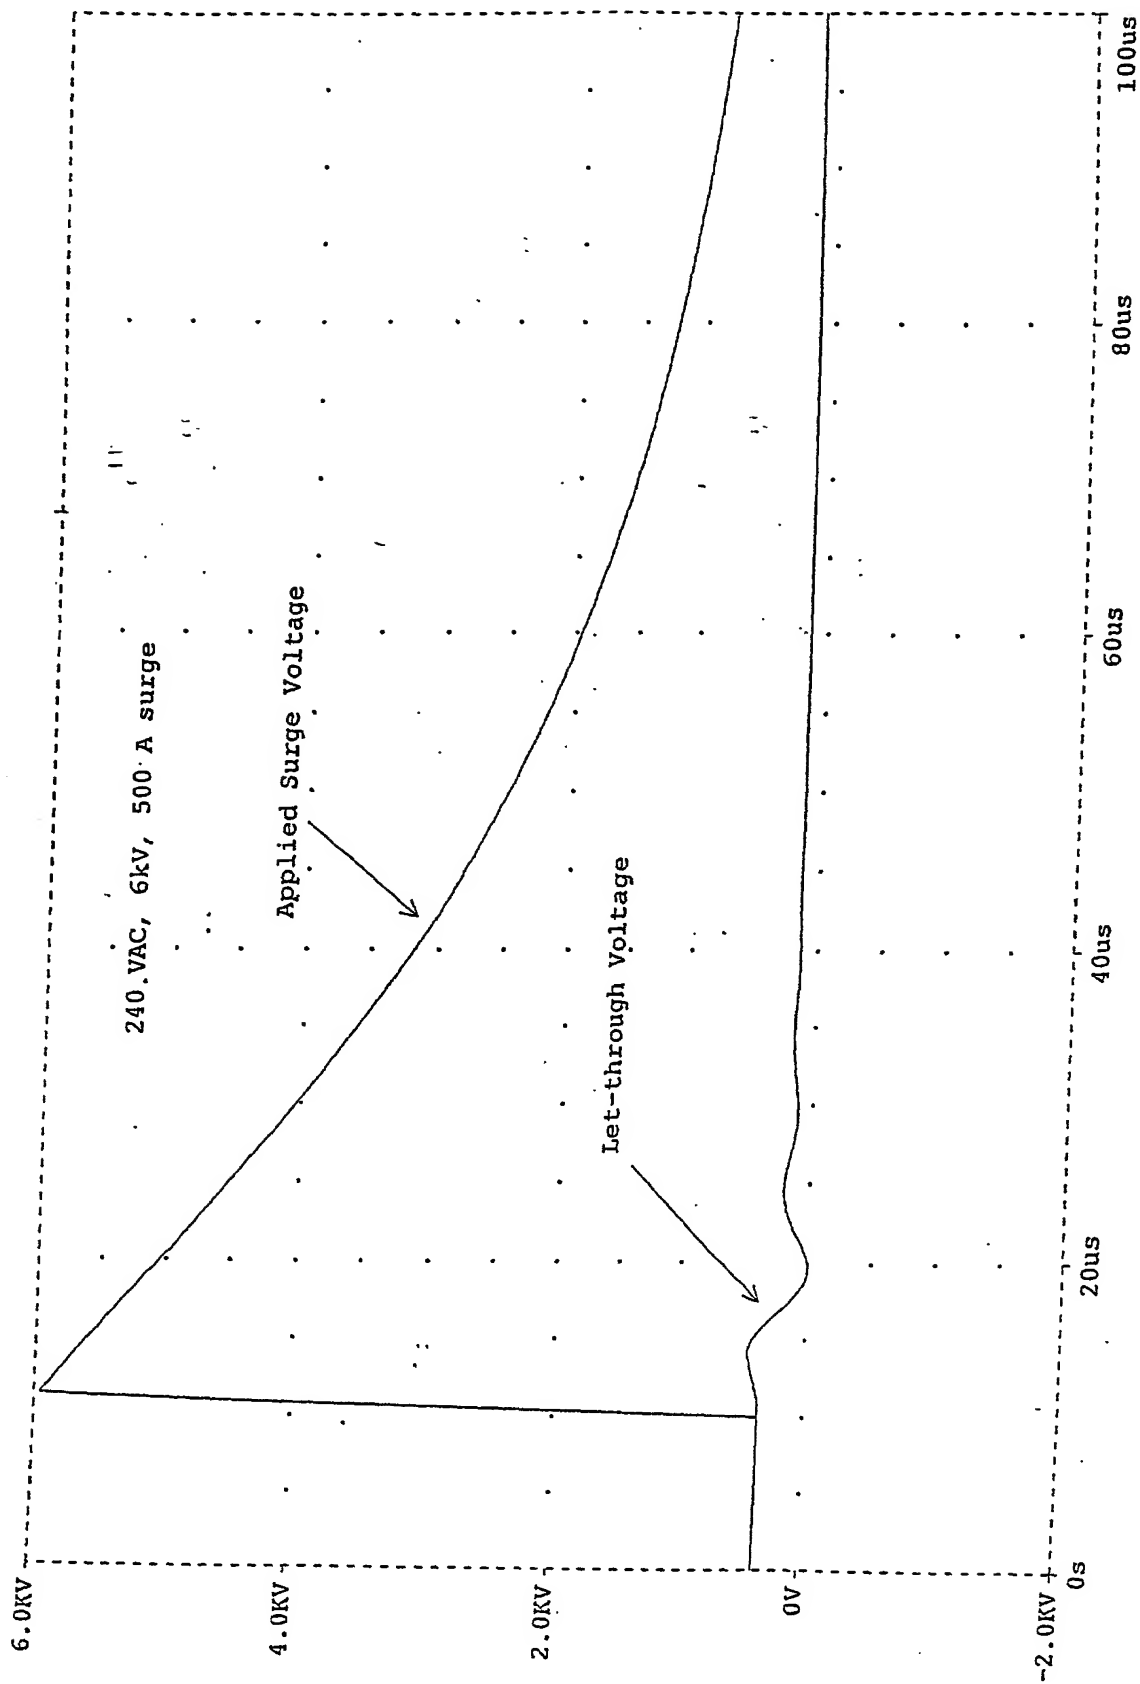


Figure 5